


1. ALL SIDEWALKS SHALL HAVE A TARGET 1.0% CROSS SLOPE. NO PORTION OF ANY SIDEWALK WILL BE ACCEPTED IF THE CROSS SLOPE EXCEEDS 2.0% OVER ANY 4 FT. WIDE SECTION.
2. ALL SIDEWALKS SHALL RECEIVE A BROOM FINISH.
3. ALL SIDEWALK EDGES SHALL HAVE A 1/2" RADIUS EDGE.
4. ALL CONCRETE SHALL BE CLASS B (3500 PSI, 4-7% AIR ENTRAINED). CONCRETE MAY NOT BE PLACED IF A FALLING AIR TEMPERATURE FALLS BELOW 40° F NOR RESUMED UNTIL AN ASCENDING AIR TEMPERATURE RISES ABOVE 35° F WITHOUT SPECIFIC AUTHORITY FROM THE CITY REPRESENTATIVE. ALL CONCRETE MATERIALS, HANDLING, PLACING, JOINTING, SAMPLING, FINISHING AND CURING SHALL BE PER CITY STANDARD SPECIFICATIONS.
5. EXPANSION JOINTS SHALL BE A MINIMUM OF 1/2" AND EXTEND THE FULL DEPTH OF THE CONCRETE. EXPANSION JOINT MATERIAL SHALL MEET AASHTO M213 FOR AN ASPHALTIC FIBER EXPANSION JOINT MATERIAL AND BE INSTALLED WITH A ZIP STRIP WHICH IS REMOVED AFTER THE CONCRETE HAS CURED AND SEALED WITH A MASTIC SEALER.
6. CONTRACTION JOINTS SHALL BE PLACED AT 5 FOOT INTERVALS.\*
7. WHEN PLACING SIDEWALK AGAINST AN EXISTING CONCRETE STRUCTURE WHERE IT IS DESIRABLE THAT THE SIDEWALK REMAIN FLUSH, THE SIDEWALK SHALL BE DOWELED INTO THE STRUCTURE.
8. ALL SIDEWALK BASE SHALL BE PLACED ON FIRM, STABLE SUBGRADE.
9. CITY SHALL INSPECT ALL SIDEWALKS IN PUBLIC RIGHT OF WAY PRIOR TO CONCRETE PLACEMENT. PROVIDE 24 HOURS NOTICE PRIOR TO PLACEMENT.
10. CONTACT CITY FOR ACTUAL GREENSPACE AND SIDEWALK WIDTHS REQUIRED PRIOR TO BEGINNING OF CONSTRUCTION. SIDEWALK AND GREENSPACE WIDTH MAY BE VARIED TO MATCH EXISTING FEATURES IF APPROVED BY THE PLANNING STAFF.

SUBGRADE BENEATH SIDEWALK SHALL BE STABLE AND FIRM WITH ORGANIC MATERIALS REMOVED.

### CONNECTION TO CONCRETE STRUCTURES

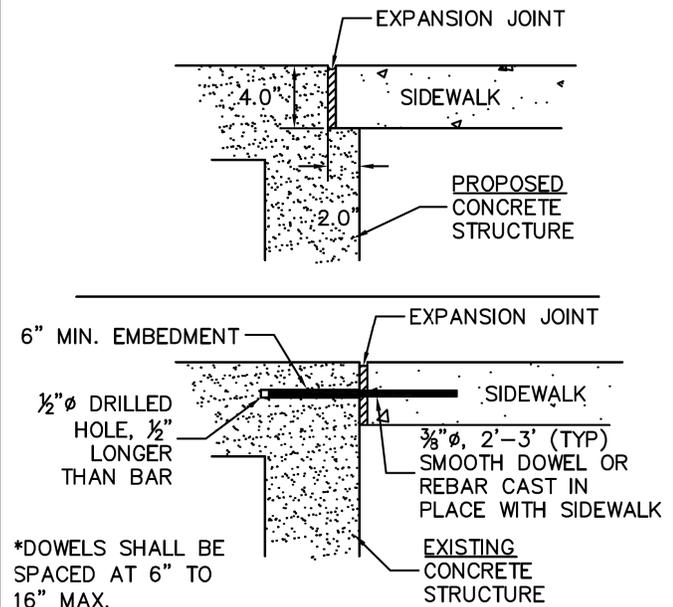

## CITY OF ROGERS

301 WEST CHESTNUT STREET  
 ROGERS, ARKANSAS 72756  
 (479) 621-1186

# TYPICAL SIDEWALK DETAILS

NOT TO SCALE

SEPTEMBER 23, 2016